

# Substation Power Distribution House



# Substation Power Distribution House

Lineup includes:

(8) Cutler-Hammer Vacuum Circuit Breaker  
Type 150VCP-W500  
Style 3A73950G01  
1200 Amp  
w/ GE 750 Feeder Management Relays

(1) Cutler-Hammer VCB  
Type 50VCP-W250  
Style 8075A32G01  
2000 Amp  
w/ Circuit Shield Undervoltage Relay and GE 750 FMR

(1) AC Panel  
(1) 48 Volt DC Panel

Also in building PLC Panel w/ PanelView 1000, Control Logix PLC

Control Building Shipping Dims:  
12'6" wide x 38' length x 11'4" height



  
**Cutler-Hammer**  
**Vacuum**  
**Circuit Breaker**  
**VCP-W**


Type	25kV VCP-W	Order No.	610475234
Style	600/300/100	SI	30-3750-11
Weight	418 Lbs.	Wiring Diagram	691C280044
Max. Bus Voltage	4.76 kV	Make Voltage	45 VDC
Insulator Voltage	60 kV Peak	Close Current	11.5 S A
Max. Cont. Current	2000 A	Voltage Range	30-50 VDC
Max. Frequency	60 Hz	Trip - 1 Current	17.5 S A
Max. S-C Current	275 kA	Voltage Range	20-50 VDC
V Range Trip - 1	1-24	Trip - 2 Current	
Max. Integ. Time	5 Cycle	Voltage Range	
Chk. Current	57 kA Peak	SR Trip Voltage	



  
**Cutler-Hammer**  
**Vacuum**  
**Circuit Breaker**  
**VCP-W**

Type	25kV VCP-W	Order No.	610475234
Style	600/300/100	SI	30-3750-11
Weight	254 Lbs.	Wiring Diagram	691C280044
Max. Bus Voltage	4.76 kV	Make Voltage	45 VDC
Insulator Voltage	60 kV Peak	Close Current	11.5 S A
Max. Cont. Current	2000 A	Voltage Range	30-50 VDC
Max. Frequency	60 Hz	Trip - 1 Current	17.5 S A
Max. S-C Current	275 kA	Voltage Range	20-50 VDC
V Range Trip - 1	1-24	Trip - 2 Current	
Max. Integ. Time	5 Cycle	Voltage Range	
Chk. Current	57 kA Peak	SR Trip Voltage	

# Cabinet arrangement as it sits.

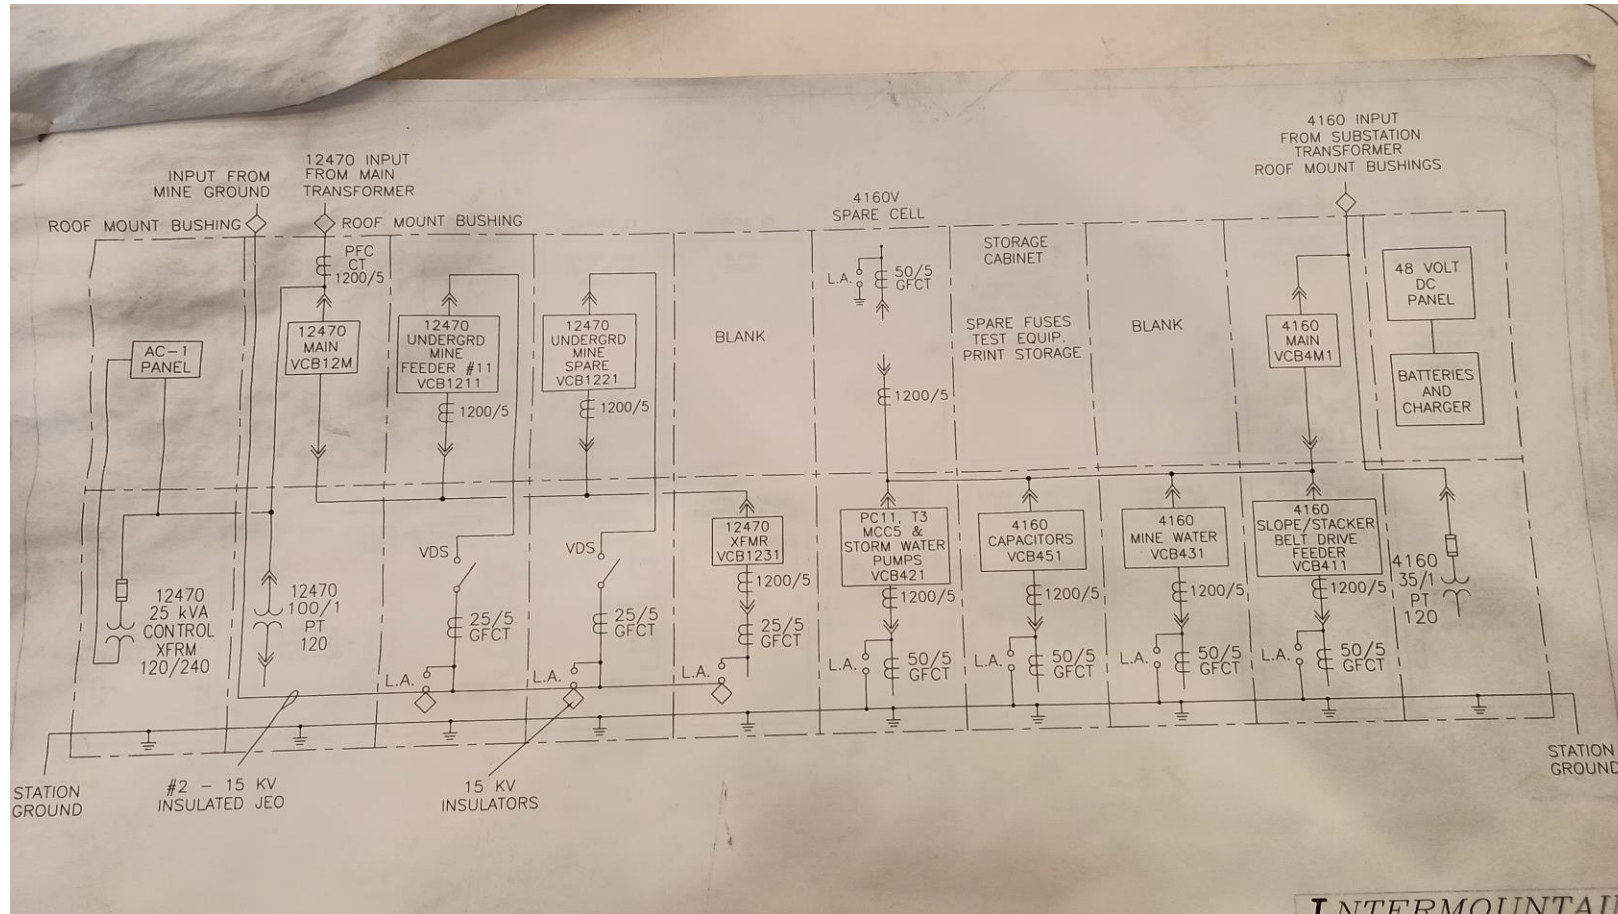

Contact us Today!


Office: 618-708-3088

Chris Sinn

Cell: 618-304-9631

Nick Stork

Cell: 618-317-6238

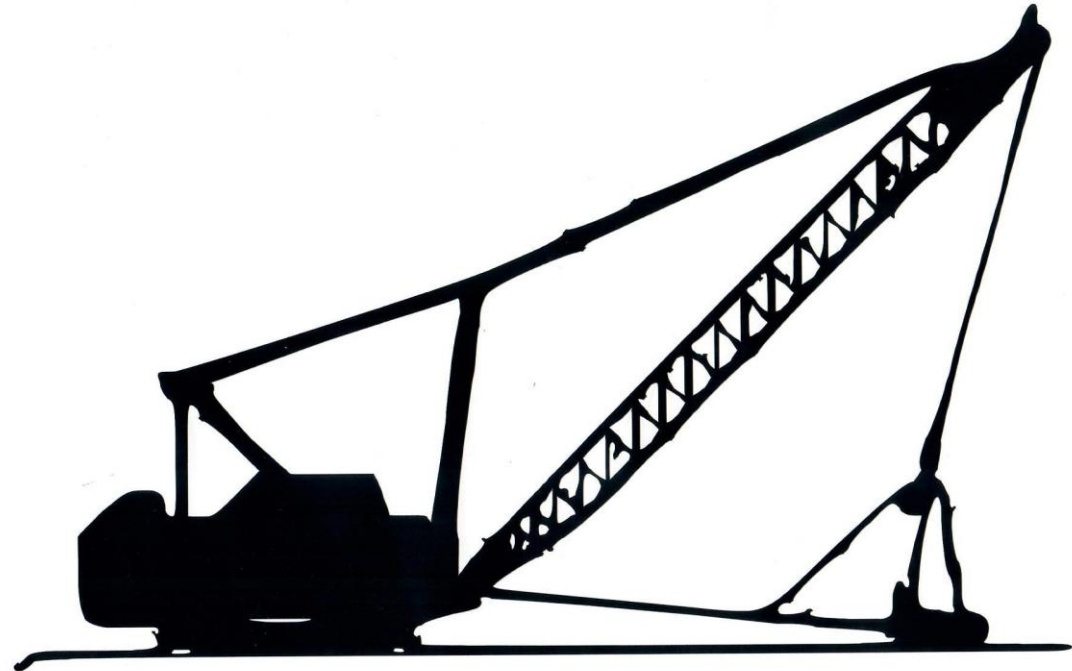

*Stork, Inc.*

*Sparta, Illinois*